OSP Cabinet Replacement Fans

"DMS-100 OPM BFU / DMS-1 URBAN"

(Not for use in Nortel Access Node Fan Trays)

Uniti UBuy # TFDMS06
48V Replacement Fan for
Booster Fan Unit (BFU) found in
DMS-100 OPM Cabinets

w/ Power Prongs,
Unterminated Tach Lead
& (1) Butt Splice

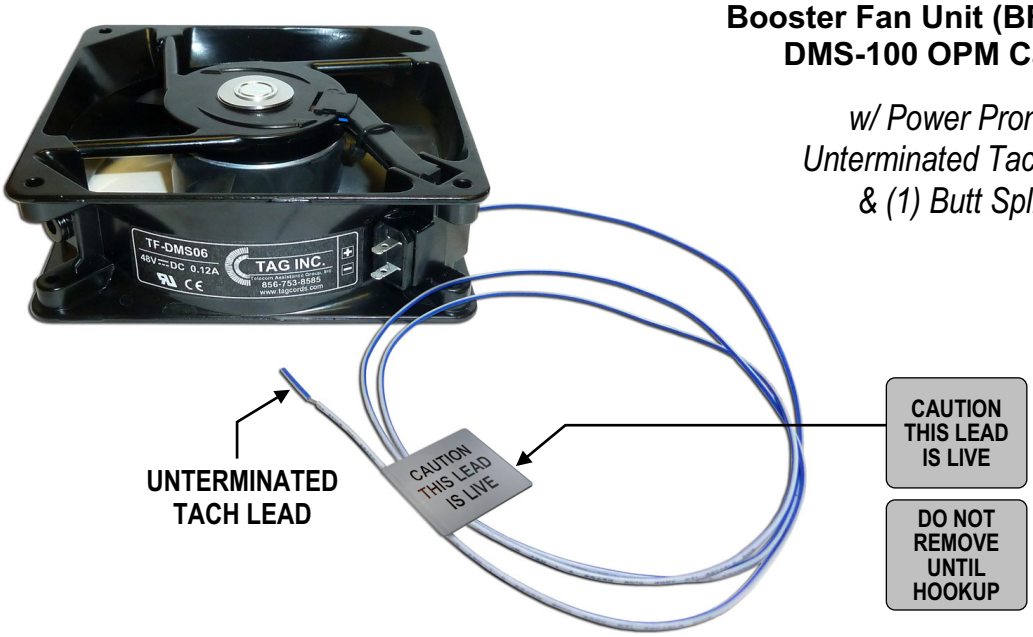

DMS-100 OPM CABINET
BOOSTER FAN UNIT (BFU) w/ EXISTING FANS

Also used in DMS-1
URBAN EMC RT BAY
*(**NT4A44AA** fan unit)*

Ordering Information:

	Uniti UBuy #
48 Volt Replacement Fan for Booster Fan Unit (BFU) found in DMS-100 OPM Cabinets w/ Power Prongs, Unterminated Tach Lead & (1) Butt Splice *(also used in DMS-1 URBAN EMC RT BAY (**NT4A44AA** fan unit))*	**TFDMS06**

150 Cooper Rd. (F-15)
W. Berlin, NJ 08091

Telephone: (856) 753-8585
Fax : (856) 768-7645

www.tagcords.com

Telecom Assistance Group

Copyright © 2026 by Telecom Assistance Group, Inc.