


DMS-100 Replacement Fans

"DMS-100 (48VDC)"

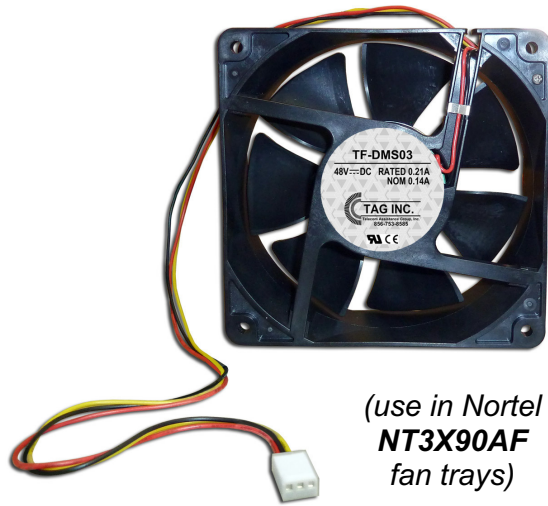

(use in Nortel
NT3X90AF
fan trays)


NORTEL NT3X90AF →
DMS-100 SWITCH BAY (DC POWERED)
w/ EXISTING FANS (5 FANS PER TRAY)

PN # TF-DMS03

48V Replacement Fan for **DMS-100**
w/ TTL Tach & 3 Wire Plug

AT&T PID # ATT.200003614

NEW Alarm Control Boards are also available,
order # **TFC-3X90AF-01** (AT&T PID # **ATT.200006499**)

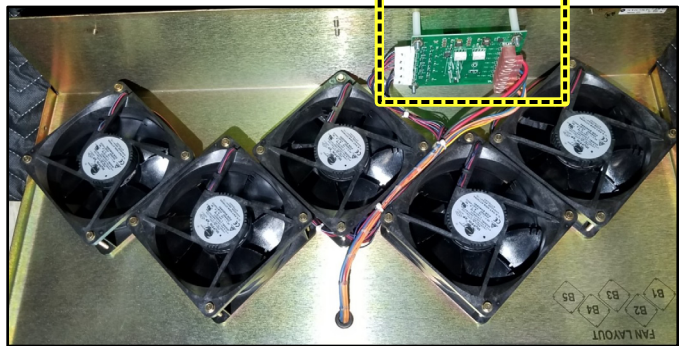

"DMS-100 (24VAC)"



PN # TF-DMS04AC

24 VAC Replacement Fan for
DMS-100 NT3X90
AC Powered Fan Trays
w/ Power Prongs


(use in Nortel **NT3X90AA** & **NT3X90AB** fan trays)

AT&T PID # ATT.200006516



DO YOU HAVE BROKEN
DMS SENSOR PADDLES
THAT NEED TO BE REPLACED?

TAG's 24VAC to 48VDC
Fan Tray Conversion Kit 4
w/ built in Sensors (no paddles)
(TFT-DMS48KIT4,
AT&T PID # ATT.200006519)
is the recommended

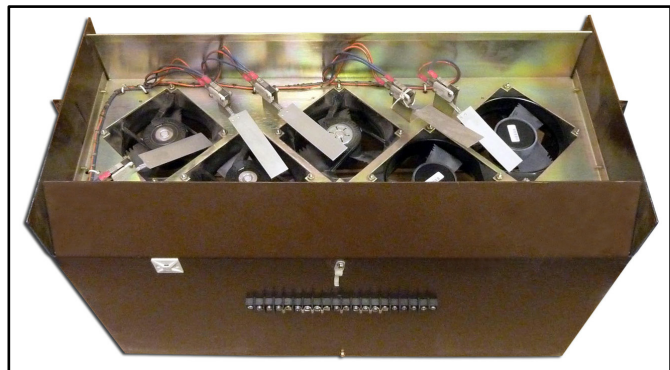

NORTEL NT3X90AA / NT3X90AB
DMS-100 SWITCH BAY (AC POWERED)
w/ EXISTING FANS (5 FANS PER TRAY)

150 Cooper Rd. (F-15)
W. Berlin, NJ 08091

www.tagcords.com

Telephone: (856) 753-8585

Fax : (856) 768-7645

Telecom Assistance Group