


# OSP Cabinet Replacement Fans

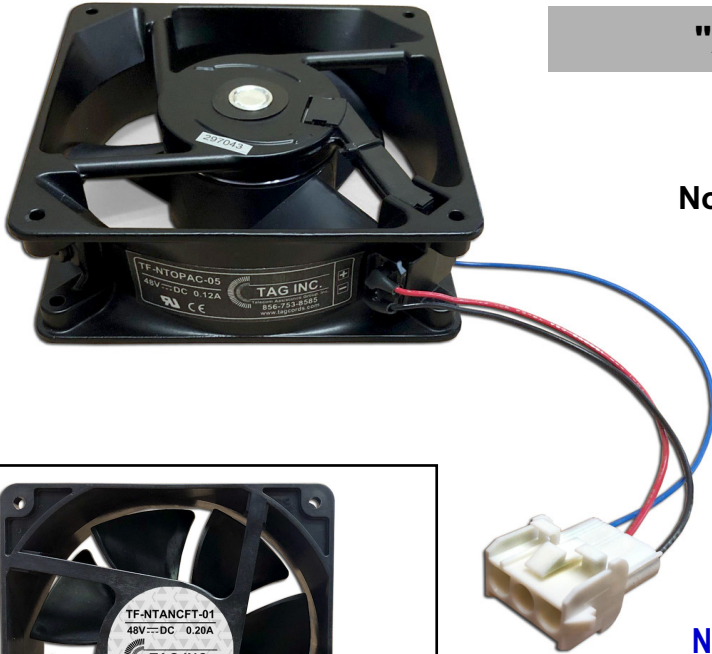

## "ACCESS NODE / 800A"


**PN # TF-NTOPAC-05**  
 48V Replacement Fan for  
 Nortel Opac Access Node Tray  
 / 800A Cabinet

w/ 3 Wire (w/ Blue FPS Lead)  
 & 3 Pin Plug

(use in tray # NT4K0610)



**NT4K0610 FAN TRAY (HAS (8) FANS)**  
 (fan tray is not included)

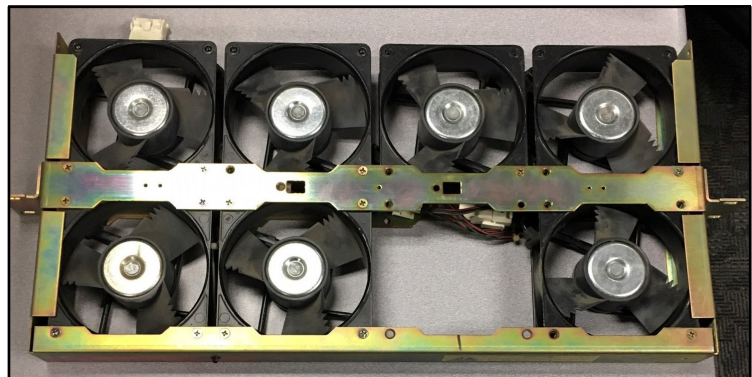

(Charles Tray Fans (92-FAN840-X)  
 are also available  
 # TF-NTANCFT-01 (ATT.200008228)

### Ordering Information:

		<b>AT&amp;T PID #</b>
<b>TF-NTOPAC-05</b> (with plug)	<b>48V Fan for Nortel Opac Access Node Tray / 800A Cabinet</b> w/ 3 Wire (w/ Blue FPS Lead) & 3 Pin Plug (use in tray # NT4K0610)	<b>ATT.200008224</b>
<b>TF-NTOPAC-05F</b> (without plug)	<b>48V Fan for Nortel Opac Access Node Tray / 800A Cabinet</b> w/ Power Prongs, Unterminated FPS Lead & (1) Butt Splice (use in tray # NT4K0610)	<b>ATT.200008225</b>
<b>TF-NTANCFT-01</b>	<b>48V Fan for Nortel Access Node / Charles Fan Tray</b> w/ 3 Wire Plug (use in tray # 92-FAN840-X)	<b>ATT.200008228</b>

150 Cooper Rd. (F-15)  
 W. Berlin, NJ 08091

[www.tagcords.com](http://www.tagcords.com)

Telephone: (856) 753-8585  
 Fax : (856) 768-7645

**Telecom Assistance Group**